

Haley Drinking Water System

Waterworks # 250001233
System Category – Small Municipal Residential

Annual Water Report

Prepared For: The Township of Whitewater Region

Reporting Period of January 1st – December 31st 2025

Issued: February 13, 2026

Operating Authority:



This report has been prepared to satisfy the annual reporting requirements in O.Reg 170/03 Section 11 and Schedule 22

Table of Contents

Report Availability	1
Compliance Report Card	1
System Process Description	1
Raw Source	1
Treatment.....	2
Distribution.....	2
Summary of Non-Compliance	2
Adverse Water Quality Incidents.....	2
Non-Compliance	3
Non-Compliance Identified in a Ministry Inspection:.....	3
Flows	3
Raw Water Flows	3
Treated Water Flows	4
Regulatory Sample Results Summary	5
Microbiological Testing.....	5
Operational Testing	5
Inorganic Parameters	5
Organic Parameters	6
Additional Legislated Samples.....	8
Maintenance Summary	8
Summary of Complaints	8
RSRS Data and Submission Confirmation	A

Report Availability

The annual report will be available to residents at the Township of Whitewater Region’s Municipal Office and copies provided free of charge if requested. The Township of Whitewater Region’s Municipal Office is located at, 44 Main Street, Cobden, Ontario.

There are no additional drinking water systems that receive water from this facility.

Compliance Report Card

Compliance Event	# of Events
Ministry of Environment Inspections	1 MECP Inspection on June 26, 2025 with a rating of 100%
Ministry of Labour Inspections	0
QEMS External Audit	1 Reaccreditation Audit completed on April 16 th 2024 by Intertek. No major or minor non-conformances were identified.
AWQI's/BWA	1 AWQI – See Summary of Non-Compliance for Details / 0 BWA
Non-Compliance	0
Community Complaints	0
Spills	0
Watermain Breaks	0

System Process Description

Raw Source

The Haley DWS drinking water is drawn from two ground water production wells. Both wells are located outside the treatment plant, in a fenced enclosure at 565 Heather Place, in Haley Station Ontario. Well #1 was drilled in late 2005, measuring 150 mm in diameter, 61 m deep and is equipped with a submersible pump rated at 115 L/min at a total dynamic head of 42 m. Well 1 is not under the direct influence of surface water.

Well #2 was drilled in September 2006, measuring 150 mm diameter, 103 m deep and is equipped with a submersible pump rated at 115 L/min with a total dynamic head of 42 m. Well #2 is potentially ground water under the direct influence of surface water (GUDI) however, there is adequate in-situ filtration.

Treatment

Raw water enters the treatment plant via one of two 50 mm discharge lines, one for each well, before joining a common header and being injected with sodium hypochlorite from one of two chemical metering pumps. A below-grade 12 m long pipeline provides contact time for disinfection to occur. Treated water leaving the plant is continuously monitored for chlorine residual.

Distribution

This Class 2 Water Distribution and Supply system supplies treated water to 34 single family homes. The most recent estimate of the population served is 96 people. An examination of the residential services completed in 2002, confirmed the absence of cross-connections. The complete replacement of all distribution piping occurred in the fall of 2010.

A hydraulic pressure tank, which is essential in maintaining adequate pressure in the distribution system during the time it takes to switch between the production wells, is located at 532 Sullivan Street. The townsite is presently without hydrant-based fire protection since the hydrants have been disconnected from their water supply. Sampling/flushing stations are installed at two dead end locations at Heather Street and Sullivan Street.

Treatment Chemicals used during the reporting year:

Chemical Name	Use	Supplier
Sodium Hypochlorite (12%)	Disinfection	Brenntag Canada Inc.

Summary of Non-Compliance

Adverse Water Quality Incidents

Date	AWQI #	Location	Problem	Details	Corrective Action Taken
11/01/2025	170610	Plant/ Distribution	Loss of pressure	Leak in chlorine injection line caused low chlorine residual to lock out the plant causing suspected loss of pressure in the distribution system.	Switched to the backup chlorine pump and started the plant back up and isolated the cracked line. Upon further investigation, it was concluded that the system did not incur a complete loss of pressure. The pressure tank for the system was reading a normal distribution pressure and did not need re-charging which indicates that it did not lose all pressure, and system users reported having water supply with pressure.

Non-Compliance

Legislation	requirement(s) system failed to meet	duration of the failure (i.e. date(s))	Corrective Action	Status
None to report.				

Non-Compliance Identified in a Ministry Inspection:

Legislation	requirement(s) system failed to meet	duration of the failure (i.e. date(s))	Corrective Action	Status
None to report.				

Flows


The Haley Drinking Water System is operating on average under half the rated capacity.

Raw Water Flows

The Raw Water flows are regulated under the Permit to Take Water (PTTW). 2025 Raw Flow Data was submitted to the Ministry electronically under permit #P-300-8175675490. The confirmations of the data submitted are attached in Appendix A.


Well 1 Total Monthly Flows

Max Allowable - PTTW

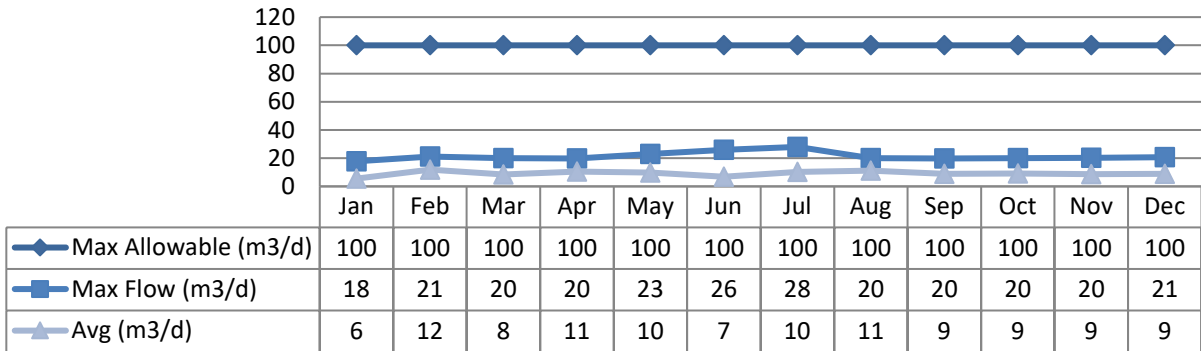

Well 1 Maximum Flow Rates


Max Allowable Rate - PTTW

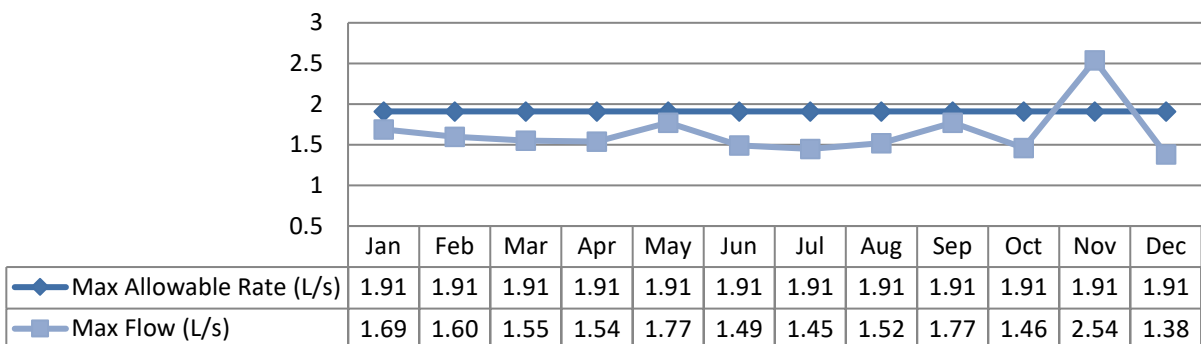

*Note: the spike in flow rate that was above the max allowable rate were on well pump start up to re-pressurize the system and lasted less than a minute, events under a minute are not reportable as a PTTW exceedance


Well 2 Total Monthly Flows

Max Allowable - PTTW

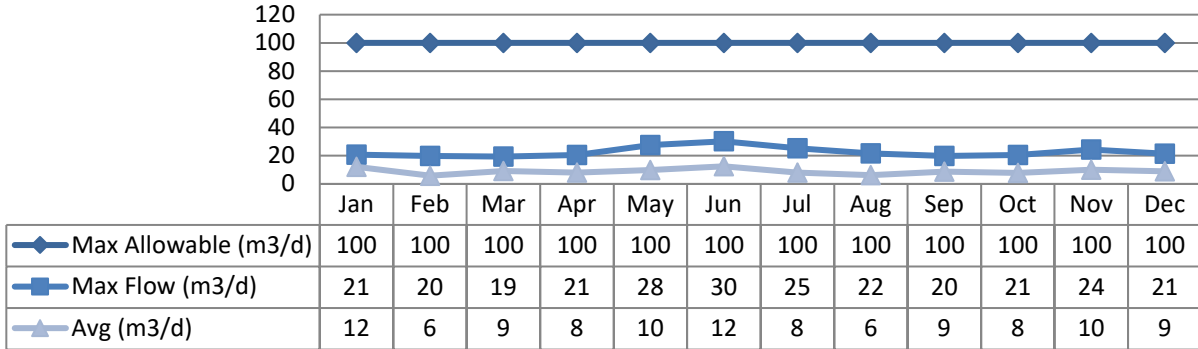

Well 2 Maximum Flow Rates

Max Allowable Rate - PTTW

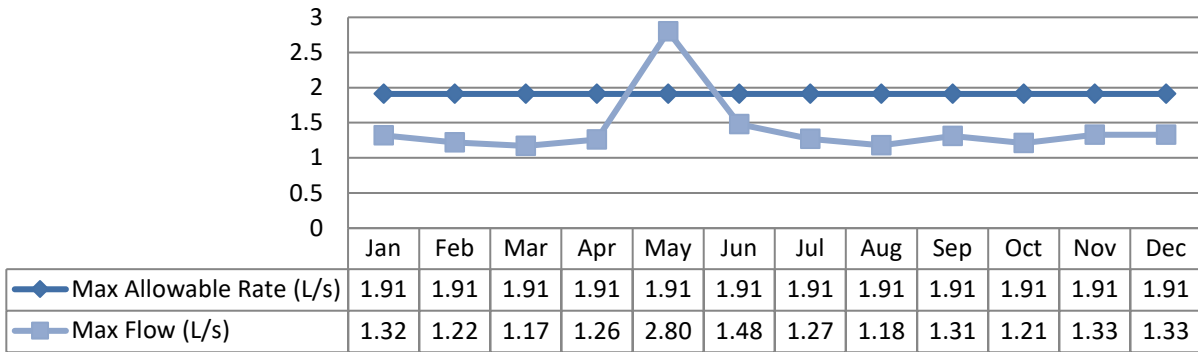


*Note: the spike in flow rate that was above the max allowable rate was during distribution system flushing and lasted less than a minute, events under a minute are not reportable as a PTTW exceedance

Treated Water Flows


Treated water flows are regulated under the Municipal Drinking Water Licence (MDWL).

Treated Flows

Rated Capacity - MDWL

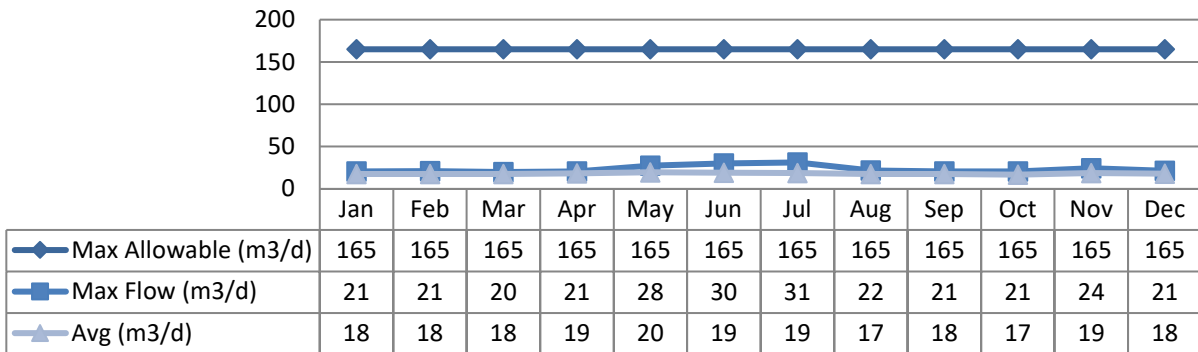

Annual Total Flow Comparison

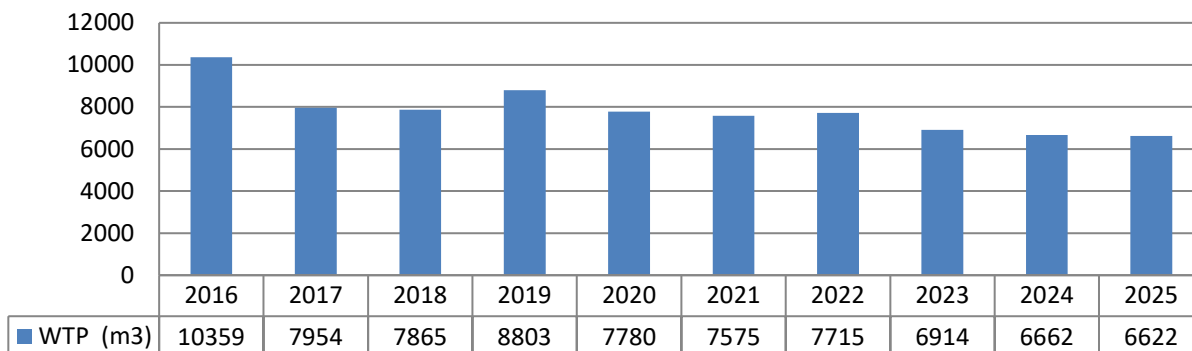

Regulatory Sample Results Summary

Microbiological Testing

	No. of Samples Collected	Range of E.Coli Results		Range of Total Coliform Results		Range of HPC Results	
		Min	Max	Min	Max	Min	Max
Raw Water Well 1	12	0	0	0	0	N/A	N/A
Raw Water Well 2	12	0	0	0	0	N/A	N/A
Distribution Water	29	0	0	0	0	0	2

Operational Testing

	No. of Samples Collected	Range of Results	
		Minimum	Maximum
Turbidity, In-House (NTU) - RW1	29	0.10	3.92
Turbidity, In-House (NTU) - RW2	33	0.08	1.04
Turbidity, In-House (NTU) - TW	240	0.06	1.23
Free Chlorine Residual, On-Line (mg/L) - TW	8760	0.38	2.84
Free Chlorine Residual, In-House (mg/L) - DW	99	0.71	1.67

NOTE: Spikes recorded by on-line instrumentation were a result of air bubbles and various maintenance/calibration activities. All spikes are reviewed for compliance with O. Reg. 170/03

Inorganic Parameters

These parameters are tested as a requirement under O. Reg. 170/03. Sodium and Fluoride are required to be tested every 60 months. Nitrate and Nitrite are tested quarterly and metals are tested every 60 months as required under O. Reg. 170/03. In the event any parameter exceeds half the maximum allowable concentration the parameter is required to be sampled quarterly.

- MAC = Maximum Allowable Concentration as per O.Reg 169/03
- <MDL = Less than Method Detection Limit

	Sample Date (yyyy/mm/dd)	Sample Result	MAC	No. of Exceedances	
				MAC	1/2 MAC
Treated Water					
Antimony: Sb (ug/L) - TW	2021/01/13	<MDL 0.9	6.0	No	No
Arsenic: As (ug/L) - TW	2021/01/13	0.8	10.0	No	No
Barium: Ba (ug/L) - TW	2024/01/09	607	1000.0	No	Yes
Barium: Ba (ug/L) - TW	2024/04/09	541	1000.0	No	Yes
Barium: Ba (ug/L) - TW	2024/07/02	590	1000.0	No	Yes
Barium: Ba (ug/L) - TW	2024/10/01	593	1000.0	No	Yes
Boron: B (ug/L) - TW	2021/01/13	24.0	5000.0	No	No
Cadmium: Cd (ug/L) - TW	2021/01/13	0.172	5.0	No	No
Chromium: Cr (ug/L) - TW	2021/01/13	1.36	50.0	No	No
Mercury: Hg (ug/L) - TW	2021/01/13	<MDL 0.01	1.0	No	No
Selenium: Se (ug/L) - TW	2021/01/13	0.4	50.0	No	No
Uranium: U (ug/L) - TW	2021/01/13	1.47	20.0	No	No
Additional Inorganics					
Nitrite (mg/L) - TW	2025/01/07	<MDL 0.003	1.0	No	No
Nitrite (mg/L) - TW	2025/04/01	<MDL 0.003	1.0	No	No
Nitrite (mg/L) - TW	2025/07/02	<MDL 0.003	1.0	No	No
Nitrite (mg/L) - TW	2025/10/01	<MDL 0.003	1.0	No	No
Nitrate (mg/L) - TW	2025/01/07	7.34	10.0	No	Yes
Nitrate (mg/L) - TW	2025/04/01	4.44	10.0	No	No
Nitrate (mg/L) - TW	2025/07/02	7.02	10.0	No	Yes
Nitrate (mg/L) - TW	2025/10/01	6.58	10.0	No	No
Fluoride (mg/L) - TW	2024/01/09	0.17	1.5	No	No
Sodium: Na (mg/L) - TW	2024/01/16	65.5	20*	Yes	Yes

*There is no "MAC" for Sodium. The aesthetic objective for sodium in drinking water is 200 mg/L. The local Medical Officer of Health should be notified mg/L when the sodium concentration exceeds 20 mg/L so that this information may be communicated to local physicians for their use with patients on sodium restricted diets.

Schedule 15 Sampling:

The Schedule 15 Sampling is required under O.Reg 170/03. This system is under reduced sampling. No plumbing samples were collected. Lead samples are required to be collected every 5 years and were last collected in 2021.

Distribution System	Number of Sampling Points	Number of Samples	Range of Results		MAC (ug/L)	Number of Exceedances
			Minimum	Maximum		
Alkalinity (mg/L)	2	2	302	332	N/A	N/A
pH	2	2	7.10	7.38	N/A	N/A
Lead (ug/L)	N/A	N/A	N/A	N/A	10	0

Organic Parameters

These parameters are tested every 60 months as a requirement under O. Reg. 170/03. In the event any parameter exceeds half the maximum allowable concentration the parameter is required to be sampled quarterly. Distribution samples are tested quarterly for THM's and HAA's in accordance with O. Reg.

170/03.

- MAC = Maximum Allowable Concentration as per O.Reg 169/03
- <MDL = Less than Method Detection Limit
-

	Sample Date (yyyy/mm/dd)	Sample Result	MAC	Number of Exceedances	
				MAC	1/2 MAC
Treated Water					
Alachlor (ug/L) - TW	2021/01/13	<MDL 0.02	5.0	No	No
Atrazine + N-dealkylated metabolites (ug/L) - TW	2021/01/13	<MDL 0.01	5.0	No	No
Azinphos-methyl (ug/L) - TW	2021/01/13	<MDL 0.05	20.0	No	No
Benzene (ug/L) - TW	2021/01/13	<MDL 0.32	1.0	No	No
Benzo(a)pyrene (ug/L) - TW	2021/01/13	<MDL 0.004	0.01	No	No
Bromoxynil (ug/L) - TW	2021/01/13	<MDL 0.33	5.0	No	No
Carbaryl (ug/L) - TW	2021/01/13	<MDL 0.05	90.0	No	No
Carbofuran (ug/L) - TW	2021/01/13	<MDL 0.01	90.0	No	No
Carbon Tetrachloride (ug/L) - TW	2021/01/13	<MDL 0.17	2.0	No	No
Chlorpyrifos (ug/L) - TW	2021/01/13	<MDL 0.02	90.0	No	No
Diazinon (ug/L) - TW	2021/01/13	<MDL 0.02	20.0	No	No
Dicamba (ug/L) - TW	2021/01/13	<MDL 0.2	120.0	No	No
1,2-Dichlorobenzene (ug/L) - TW	2021/01/13	<MDL 0.41	200.0	No	No
1,4-Dichlorobenzene (ug/L) - TW	2021/01/13	<MDL 0.36	5.0	No	No
1,2-Dichloroethane (ug/L) - TW	2021/01/13	<MDL 0.35	5.0	No	No
1,1-Dichloroethylene (ug/L) - TW	2021/01/13	<MDL 0.33	14.0	No	No
Dichloromethane (Methylene Chloride) (ug/L) - TW	2021/01/13	<MDL 0.35	50.0	No	No
2,4-Dichlorophenol (ug/L) - TW	2021/01/13	<MDL 0.15	900.0	No	No
2,4-Dichlorophenoxy acetic acid (2,4-D) (ug/L) - TW	2021/01/13	<MDL 0.19	100.0	No	No
Diclofop-methyl (ug/L) - TW	2021/01/13	<MDL 0.4	9.0	No	No
Dimethoate (ug/L) - TW	2021/01/13	<MDL 0.06	20.0	No	No
Diquat (ug/L) - TW	2021/01/13	<MDL 1.0	70.0	No	No
Diuron (ug/L) - TW	2021/01/13	<MDL 0.03	150.0	No	No
Glyphosate (ug/L) - TW	2021/01/13	<MDL 1.0	280.0	No	No
Malathion (ug/L) - TW	2021/01/13	<MDL 0.02	190.0	No	No
Metolachlor (ug/L) - TW	2021/01/13	<MDL 0.01	50.0	No	No
Metribuzin (ug/L) - TW	2021/01/13	<MDL 0.02	80.0	No	No
Monochlorobenzene (Chlorobenzene) (ug/L) - TW	2021/01/13	<MDL 0.3	80.0	No	No
Paraquat (ug/L) - TW	2021/01/13	<MDL 1.0	10.0	No	No
PCB (ug/L) - TW	2021/01/13	<MDL 0.04	3.0	No	No
Pentachlorophenol (ug/L) - TW	2021/01/13	<MDL 0.15	60.0	No	No
Phorate (ug/L) - TW	2021/01/13	<MDL 0.01	2.0	No	No
Picloram (ug/L) - TW	2021/01/13	<MDL 1.0	190.0	No	No
Prometryne (ug/L) - TW	2021/01/13	<MDL 0.03	1.0	No	No
Simazine (ug/L) - TW	2021/01/13	<MDL 0.01	10.0	No	No
Terbufos (ug/L) - TW	2021/01/13	<MDL 0.01	1.0	No	No
Tetrachloroethylene (ug/L) - TW	2021/01/13	<MDL 0.35	10.0	No	No
2,3,4,6-Tetrachlorophenol (ug/L) - TW	2021/01/13	<MDL 0.2	100.0	No	No

	Sample Date (yyyy/mm/dd)	Sample Result	MAC	Number of Exceedances	
				MAC	1/2 MAC
Treated Water					
Triallate (ug/L) - TW	2021/01/13	<MDL 0.01	230.0	No	No
Trichloroethylene (ug/L) - TW	2021/01/13	<MDL 0.44	5.0	No	No
2,4,6-Trichlorophenol (ug/L) - TW	2021/01/13	<MDL 0.25	5.0	No	No
2-methyl-4-chlorophenoxyacetic acid (MCPA) (ug/L) - TW	2021/01/13	<MDL 0.12	100.0	No	No
Trifluralin (ug/L) - TW	2021/01/13	<MDL 0.02	45.0	No	No
Vinyl Chloride (ug/L) - TW	2021/01/13	<MDL 0.17	1.0	No	No

Distribution samples are tested quarterly for THM's and HAA's in accordance with O. Reg. 170/03.

	Sample Date (yyyy/mm/dd)	Sample Result	MAC	Number of Exceedances	
				MAC	1/2 MAC
DISTRIBUTION WATER					
Trihalomethane (THM): Total (ug/L) – DW*	2025	14.75	100.0	No	No
Haloacetic Acid (HAA): Total (ug/L) - DW*	2025	5.3	80.0	No	No

*Running Annual Average

<MDL = Less than Method Detection Limit

MAC = Maximum Allowable Concentration as per O. Reg. 169/03

Additional Legislated Samples

No additional sampling required.

Maintenance Summary

WO #	Description
4861546	Moxa box installation
4863847	ESA inspection and repairs

Summary of Complaints

Location	Date	Nature of Complaint	Actions Taken
None to report.			

Appendix A

RSRS Data and Submission Confirmation



Client Name: THE CORPORATION OF THE TOWNSHIP OF WHITEWATER REGION Reporting Year: 2025 Service: PTTW Permit Number: P-300-8175675490 Permit Version: 1.0 New or Updated Submission: NEW

Site Name: Haley Water Treatment Plant

Source ID: 500000637580

Source Name: Well 1

Source Type: Well

UTM(Zone/Easting/Northing): 18/362875.0/5050014.0

Method of Determination: Metered

Unit of Measure: Litre

Description: Well 1

Purpose Category: Utilities

Specific Category: Municipal Supply

Activity: Water Supply

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec
1				16600.0	17000.0	18100.0					23300.0	6200.0
2				17000.0	15000.0	6000.0			15800.0	15600.0	23300.0	
3				16600.0	17700.0				15300.0	17400.0	23300.0	
4		13300.0	10400.0	15300.0	21800.0				15800.0	18500.0	17000.0	
5		18700.0	18200.0	16600.0	16000.0			14200.0	16200.0	18500.0		
6		17800.0	16800.0	17700.0	6200.0			19000.0	16800.0	18500.0		
7	11000.0	17500.0	16700.0	5500.0			21500.0	22700.0	19100.0	100.0		
8	18600.0	18900.0	17300.0				17300.0	17700.0	4000.0			11100.0
9	19600.0	22300.0	18800.0			11900.0	16900.0	17600.0				18100.0
10	18100.0	18700.0	5400.0			18700.0	17500.0	24000.0				17400.0
11	19500.0	4900.0				17500.0	17900.0	19700.0			17200.0	17700.0
12	19700.0				24700.0	20100.0	17500.0	4900.0			17200.0	16900.0
13	6800.0				24700.0	16500.0	17500.0				18700.0	16400.0
14				11600.0	24500.0	18400.0	17500.0				15500.0	19300.0
15				17300.0	21400.0	19100.0	300.0		12400.0		18300.0	4900.0
16				17900.0	18800.0	25300.0			17500.0	21200.0	18300.0	
17			13400.0	15600.0	22000.0	5500.0			19100.0	16300.0	18300.0	
18		11700.0	16700.0	17800.0	24500.0			16600.0	19900.0	19160.0	100.0	
19		17600.0	17700.0	16500.0	19800.0			16300.0	18300.0	19160.0		
20	13100.0	17000.0	16800.0	17200.0	19100.0			16000.0	15800.0	19160.0		
21	18100.0	15500.0	16400.0	18900.0	4800.0		18000.0	18100.0	18800.0			
22	17800.0	19800.0	17100.0	6100.0			18000.0	16000.0	15200.0			10300.0
23	18400.0	20500.0	18800.0				20400.0	17500.0	5200.0			17100.0
24	16800.0	18500.0	4600.0			12500.0	16400.0	21500.0				16800.0
25	16200.0	5500.0				18600.0	17400.0	5700.0			17500.0	17600.0
26	17500.0					17200.0	12700.0				17300.0	16300.0
27	3200.0				12800.0	16100.0	12700.0				18400.0	15700.0
28				13100.0	18800.0	17100.0				19500.0	16700.0	18700.0
29				17000.0	16400.0	17300.0				18000.0	18400.0	5800.0
30				19400.0	16800.0	3300.0				18800.0	18400.0	
31			12900.0		17900.0					18200.0		

Site Name: Haley Water Treatment Plant

Source ID: 500000637579

Source Name: Well 2

Source Type: Well

UTM(Zone/Easting/Northing): 18/362870.0/5050014.0

Method of Determination: Metered

Unit of Measure: Litre

Description: Well 2

Purpose Category: Utilities

Specific Category: Municipal Supply

Activity: Water Supply

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec
1	17900.0	19100.0	16800.0				18650.0	16500.0	19200.0	18000.0		11500.0
2	17900.0	21000.0	18600.0			22400.0	18650.0	18300.0	3700.0			16700.0
3	17800.0	17600.0	18100.0			24200.0	18700.0	18700.0				17700.0
4	16800.0	5500.0	6700.0			18100.0	19800.0	18600.0				17700.0
5	16700.0					16800.0	21500.0	4000.0			19360.0	17100.0
6	20000.0				10000.0	17200.0	21500.0				19360.0	17100.0
7	19700.0			11600.0	16700.0	20400.0				19300.0	19360.0	18500.0
8	7300.0			17300.0	20800.0	22100.0	100.0		14300.0	19400.0	17230.0	6500.0
9				17100.0	16600.0	6900.0			16700.0	19000.0	17230.0	
10			10700.0	16900.0	22600.0				16900.0	20200.0	17230.0	
11		12600.0	17900.0	15600.0	23600.0				15200.0	15900.0		
12		17500.0	17000.0	16700.0	3700.0			14400.0	14900.0	21700.0		
13	11100.0	17100.0	17700.0	18200.0				15600.0	16300.0	21700.0		
14	17800.0	15900.0	15900.0	4400.0				20600.0	18000.0	21700.0		
15	18700.0	18700.0	16900.0				16900.0	20600.0	4700.0	24000.0		11400.0
16	19100.0	18700.0	19300.0				16700.0	17100.0				18100.0
17	15900.0	19200.0	4600.0			13500.0	16300.0	18800.0				17600.0
18	17700.0	6700.0				21100.0	18000.0	4000.0			16900.0	16500.0
19	20000.0					15300.0	18000.0				17100.0	17400.0
20	5700.0					14700.0	18000.0				17800.0	16000.0
21					11600.0	17700.0				17200.0	17700.0	17900.0
22				10400.0	18400.0	18500.0				18400.0	18100.0	6500.0
23				16100.0	18200.0	20100.0			9900.0	18100.0	18100.0	
24			10500.0	16900.0	18200.0	5700.0			16600.0	18600.0	18100.0	
25		12000.0	15900.0	15100.0	20500.0			12600.0	15900.0	19400.0		
26		18400.0	15300.0	17100.0	18100.0			16300.0	15900.0	19400.0		
27	13900.0	16700.0	16800.0	20400.0	5800.0			18500.0	15500.0	19400.0		
28	19800.0	15700.0	16400.0	4100.0			16700.0	14600.0	17700.0			
29	19600.0		18100.0				18400.0	16000.0	17700.0			12300.0
30	16700.0		18600.0			13800.0	17400.0	15700.0	16900.0			16600.0
31	16700.0		4100.0				18300.0	17900.0				16400.0

Name of Attester

First Name: Megan

Last Name: Lockwood

Company: Ontario Clean Water Agency

Date Certified/Submitted(yyyy/mm/dd): 2026/01/28